

PUBLIC HEALTH SERVICES GOVT OF MAHARASHTRA
DISTRICT PUBLIC HEALTH LABORATORY NASHIK

Civil Hospital Campus Trimbak road, Nashik - 422001

E mail- dphlnasik@gmail.com

Phone:-0253-2570613

REPORT ON BACTERIOLOGICAL EXAMINATION OF WATER

Sender's Name :- Principal Kids Learning School
Address :- Bhendi Tal. Kalwan Dist. Nashik

Sender's Letter No. & Date :- 05/10/2023

Laboratory Reference No. :- 260

Date of Collection :- 05/10/2023

Date of Arrival at Laboratory :- 05/10/2023


Date of Commencing Examination :- 05/10/2023

Sr. No.	Particular of Water Samples	Result of Analysis			Remark
		Most Probable Number Per 100 ml.			
		Coliforms	Thermotolerant coliforms	E.coli	
1	Water Sample (R.O.) R. No : 3518312 Dt. : 05/10/2023 Rs. : 340/-	0	--	--	Potable

Result mentioned above is/are of submitted sample only.

Outward No. :- 5076/23
Date :-

51 OCT 2023


कनिष्ठ वैज्ञानिक अधिकारी
जिल्हा आरोग्य प्रयोगशाळा
नाशिक
क.ए.ए.



Maharashtra Government
DISTRICT PUBLIC HEALTH LABORATORY, NASHIK

Office Phone No.:- 0253 – 2570613

Email Id:- dphlnasik@gmail.com

Office: - Junior Scientific Officer District Public Health,
Laboratory, Civil Hospital Campus, Trimbak Road,
Nashik - 422 001.

NO. DPHL/NSK/WC/ W-220 / 5192/2023

Date:- 16 Oct 2023

Health Services

REPORT ON CHEMICAL EXAMINATION OF WATER FOR DRINKING PURPOSES

Date of Collection- ----- Date of receipt -05/10/2023 Date of Examination-05/10/2023 & onwards
Letter No.- NIL dated-05/10/2023


Analytical results in mg/litre (except pH& turbidity)

Sr. No.	Name of Test	Results	BIS Specification 10500:2012 Normal values	
			Desirable limits	Permissible limits
	Source	Well water	-----	-----
01	Physical appearance	Clear, colourless	-----	-----
02	Odour	odourless	Agreeable	Agreeable
03	pH	07.85	6.5 to 8.5	No relaxation
04	Turbidity (NTU)	0.11	1.0	5.0
05	Chlorides	57.00	250	1000
06	Total Hardness	224.00	200	600
07	Total alkalinity	211.20	200	600
08	Total dissolved solids	353.00	500	2000
09	Fluoride	N.D.	1.0	1.5
10	Iron	0.072	0.3	No relaxation
11	Nitrates	0.69	45	No relaxation
12	Permanent hardness	12.80	-----	-----

Remark 01:- Sample No.01 contains total hardness and total alkalinity more than desirable limit & hence, however, if there is no any other alternative source available nearby then this water source can be used for drinking purpose only after proper treatment, disinfection and ascertaining it's bacteriological quality frequently or regularly.

Forwarded with compliments to:
Principal
Kids Learning School
Bhendi, Tal-Kalwan, Nashik.

R.No.-3518312, Rs.940/-, Dt-05/10/2023


Junior Scientific Officer
District Public Health Laboratory,
Nashik.

Translation of rubber stamp matter from Marathi to English

Translator and Notary Public, Govt. of India here by notaries the below mentioned Rubber stamp translation from Marathi to English

Stamp in Marathi Language

English Translation

कनिष्ठ वैज्ञानिक अधिकारी


Junior Scientific Officer

जिल्हा आरोग्य प्रयोगशाळा


District Health Laboratory

नाशिक

Nashik

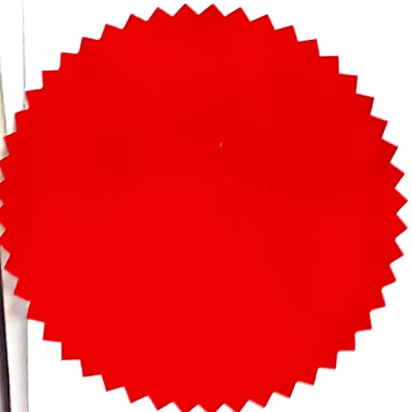

This Document Contain Page 1 to 3
Document No. registered
SL No:- 10211/22
Dated:- 19 APR 2024

BEFORE ME

Signature Of Notary
Sanjeev D. Pawar
Advocate & Notary (Govt. of India)